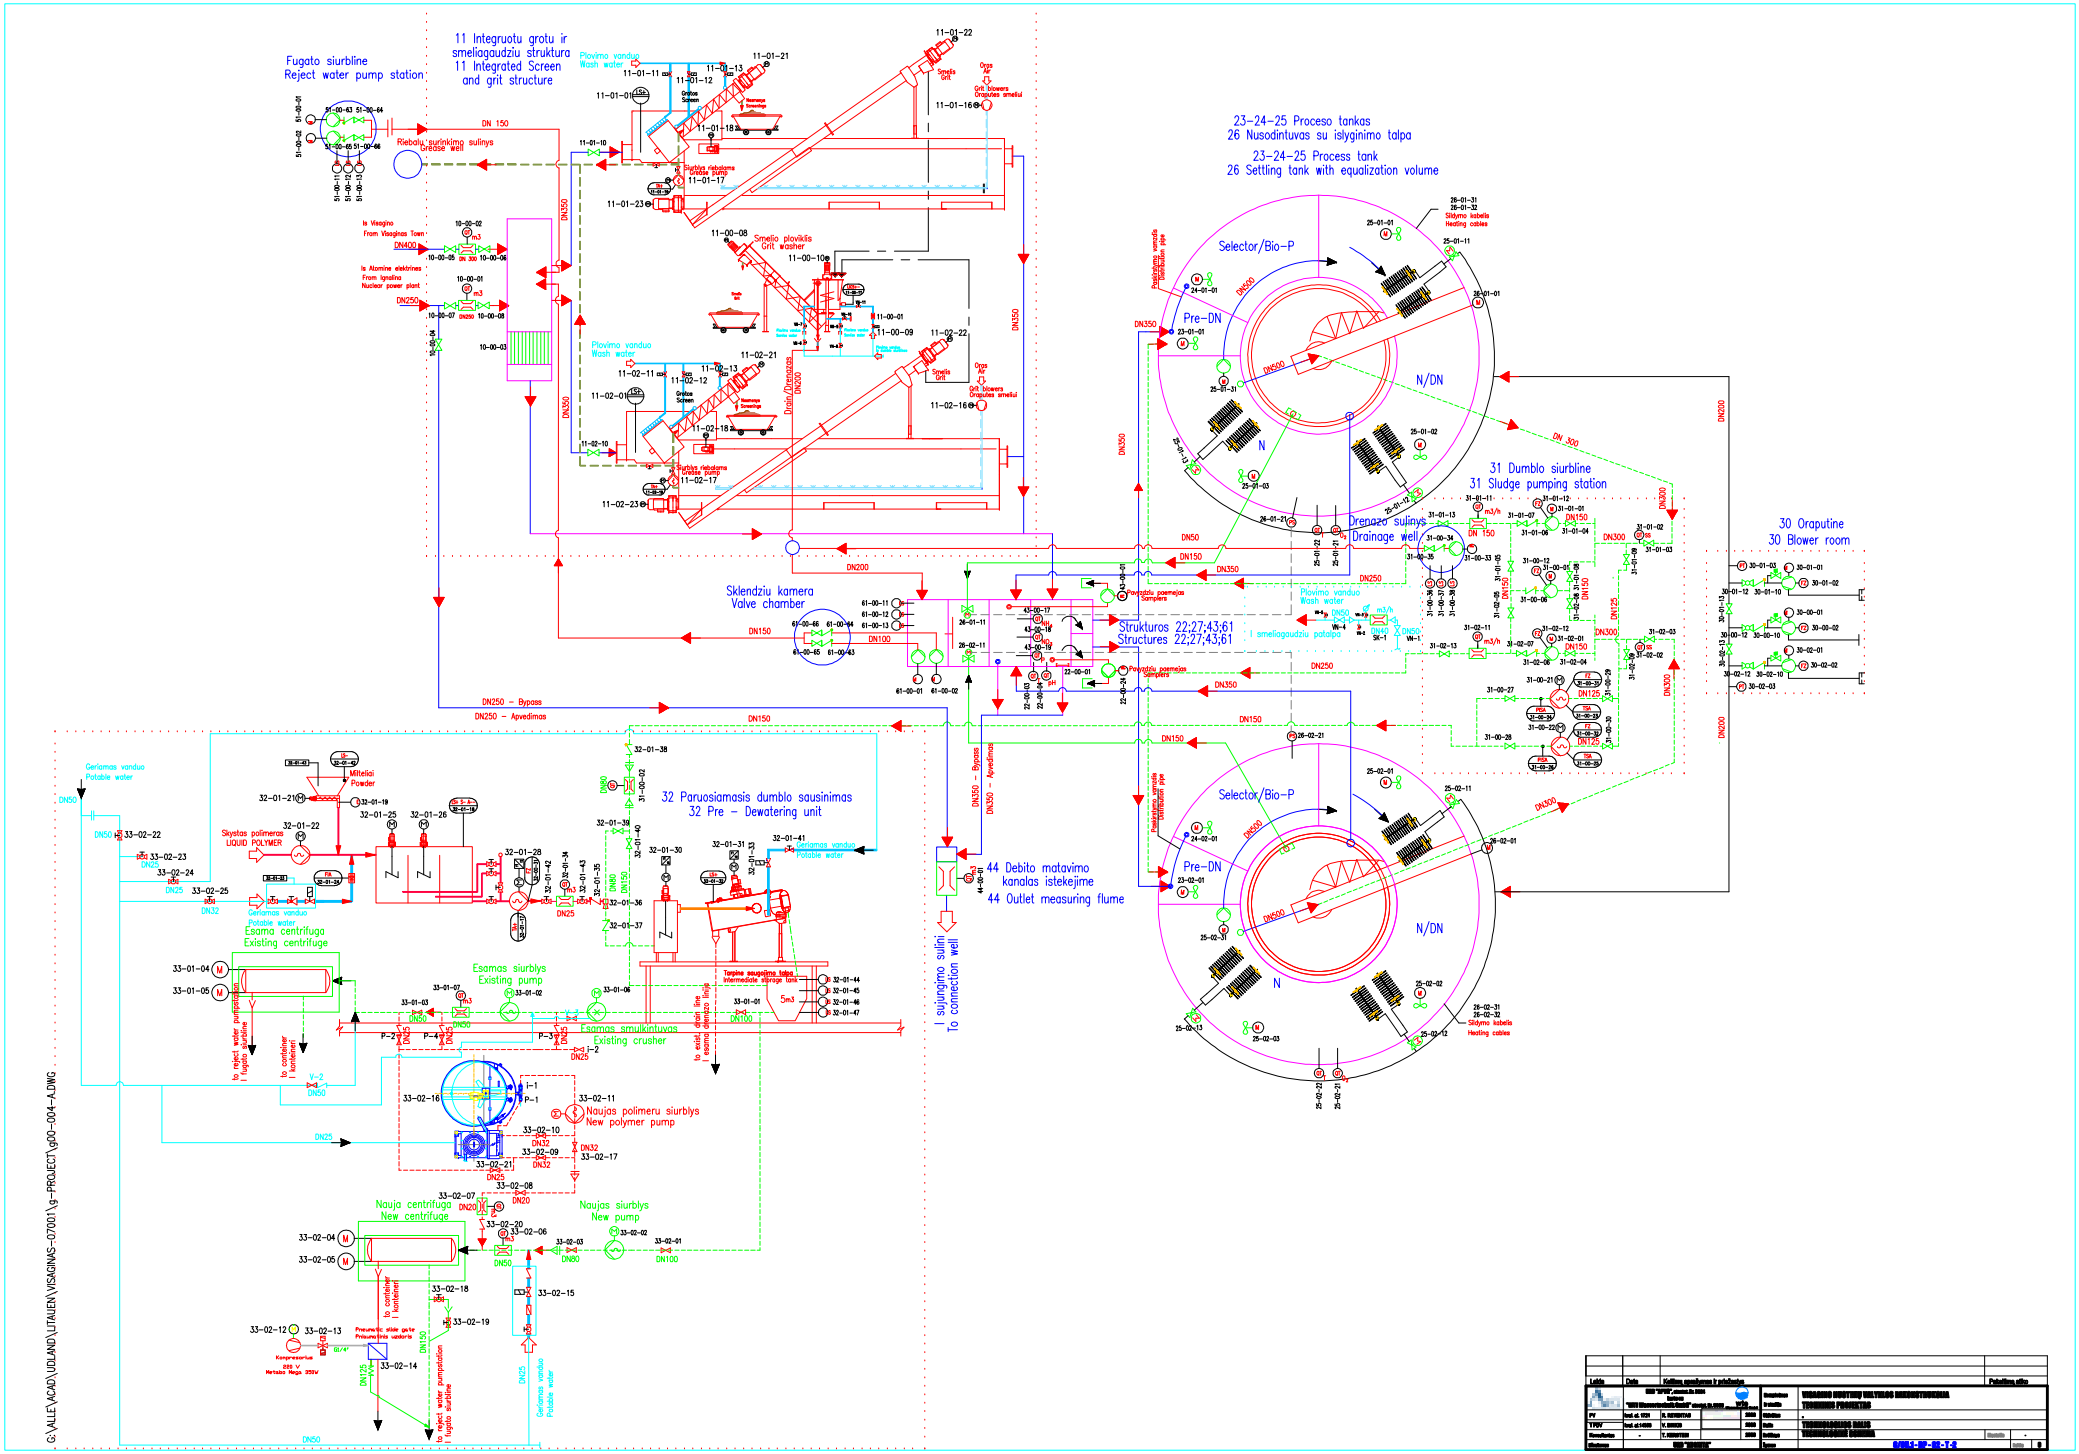
Fugato siurbline
Reject water pump station
11 Integruotu grotu ir smeliagaudziu struktura
11 Integrated Screen and grit structure
Riebalu surinkimo sulinys
Grease well
Is Visagino
From Visaginas Town
Is Atomine elektrines
From Ignalina Nuclear power plant
Plovimo vanduo
Wash water
Smelio ploviklis
Grit washer
Drenazo/Drenazas
Sklendziu kamera
Valve chamber
23-24-25 Proceso tankas
26 Nusodintuvas su islyginimo talpa
23-24-25 Process tank
26 Settling tank with equalization volume
Selector/Bio-P
Pre-DN
N/DN
N
Drenazo sulinys
Drainage well
31 Dumblo siurbline
31 Sludge pumping station
30 Oraputine
30 Blower room
Strukturos 22;27;43;61
Structures 22;27;43;61
DN250 – Bypass
DN250 – Apvedimas
32 Paruosiamasis dumblo sausinimas
32 Pre – Dewatering unit
Geriamas vanduo
Potable water
Skystas polimeras
LIQUID POLYMER
Esama centrifuga
Existing centrifuge
Esamas siurblys
Existing pump
Esamas smulkintuvas
Existing crusher
Naujas polimeru siurblys
New polymer pump
Nauja centrifuga
New centrifuge
Naujas siurblys
New pump
44 Debito matavimo kanalas istekejime
44 Outlet measuring flume
I sujungimo sulini
To connection well
to reject water pumpstation
I lugoto siurbline
to container
I konteiner
to existing drain line
I esama drenazo linija
Kompresorius
Metalo Mega 220V
Pneumatic slide gate
Pneumatiniu vaduotu