

2024.11.05
Suderinta:
Šalčininkų rajono savivaldybės administracijos
Komunalinio ūkio skyriaus
Vadovo pavaduotoja
Justyna Dovgialo


Tvirtinu:
UAB "Šalčininkų šilumos tinklai"
I. e. p. direktorė

Elena Pumputienė

2024 m.

spalio 7 d.

Lauko oro tempe- ratūra, C	Termofikac. vandens t-ra	
	Paduodama, C su 3% paklaida	Grįžtama, C
8,0	45,0	37,2
7,0	45,5	37,2
6,0	46,0	37,6
5,0	46,5	38,0
4,0	47,0	38,4
3,0	47,5	38,9
2,0	48,0	39,2
1,0	48,5	39,5
0,0	49,0	40,0
-1,0	50,0	40,9
-2,0	51,0	41,3
-3,0	52,0	42,1
-4,0	53,0	42,7
-5,0	54,0	43,5
-6,0	55,0	44,2
-7,0	56,0	44,5
-8,0	57,5	44,8
9,0	59,0	45,1
-10,0	60,0	45,4
-11,0	61,0	45,6
-12,0	61,5	45,8
-13,0	62,0	46,0
-14,0	62,5	46,2
-15,0	63,0	46,9
-16,0	63,5	47,5
-17,0	64,0	47,9
-18,0	64,5	48,5
-19,0	65,0	49,2
-20,0	65,5	49,8
-21,0	66,0	50,0
-22,0	66,5	50,8
-23,0	67,0	51,4
-24,0	67,5	52,0
-25,0	68,0	52,8

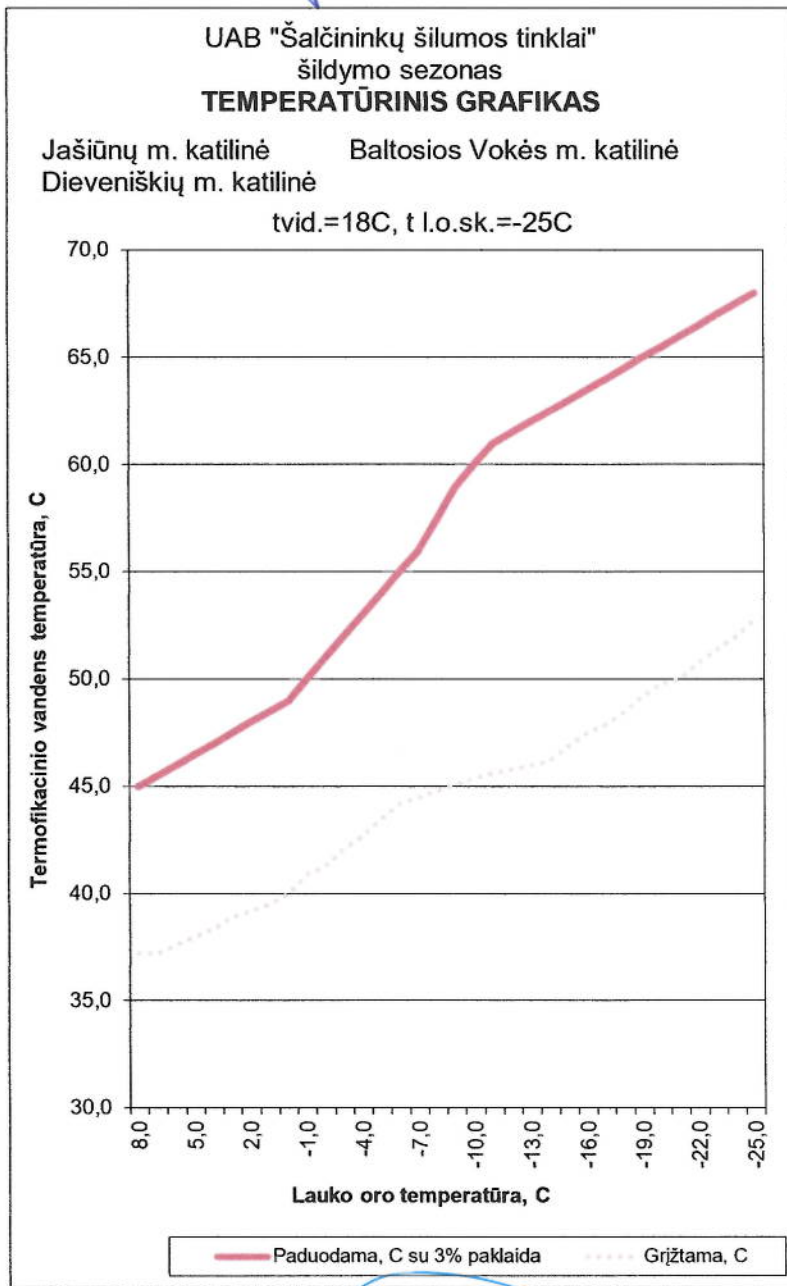

Sudarė: Pastatų ir tinklų eksploatavimo skyriaus vadovas A. Švaikovskij